

# DOUBLE POLE TOGGLE SWITCH

## WIRING FOR TWO MOTORS TO A DOUBLE POLE TOGGLE SWITCH

◦ **NOTICE:** For installation by a qualified electrician in accordance with national and local electrical codes, and the following instructions.

◦ **CAUTION:** RISK OF ELECTRICAL SHOCK. Disconnect power before installing. Never wire energized electrical components.

◦ Select conductors having 90°C or higher rated insulation having sufficient ampacity in accordance with the 60°C column of National Electrical Code® table 310-16 or Canadian Electrical Code Table 2.


◦ Terminal capacity: #14 AWG to #10 AWG

◦ Strip conductors using strip gage on switch body.  
DO NOT USE TIN CONDUCTORS.

### ⚠ **WARNING:**

- **DO NOT** wire more than one operator to a single pole switch. A second operator can be wired to the second pole of a double pole switch.

- **DO NOT** connect two switches to an operator without a relay.

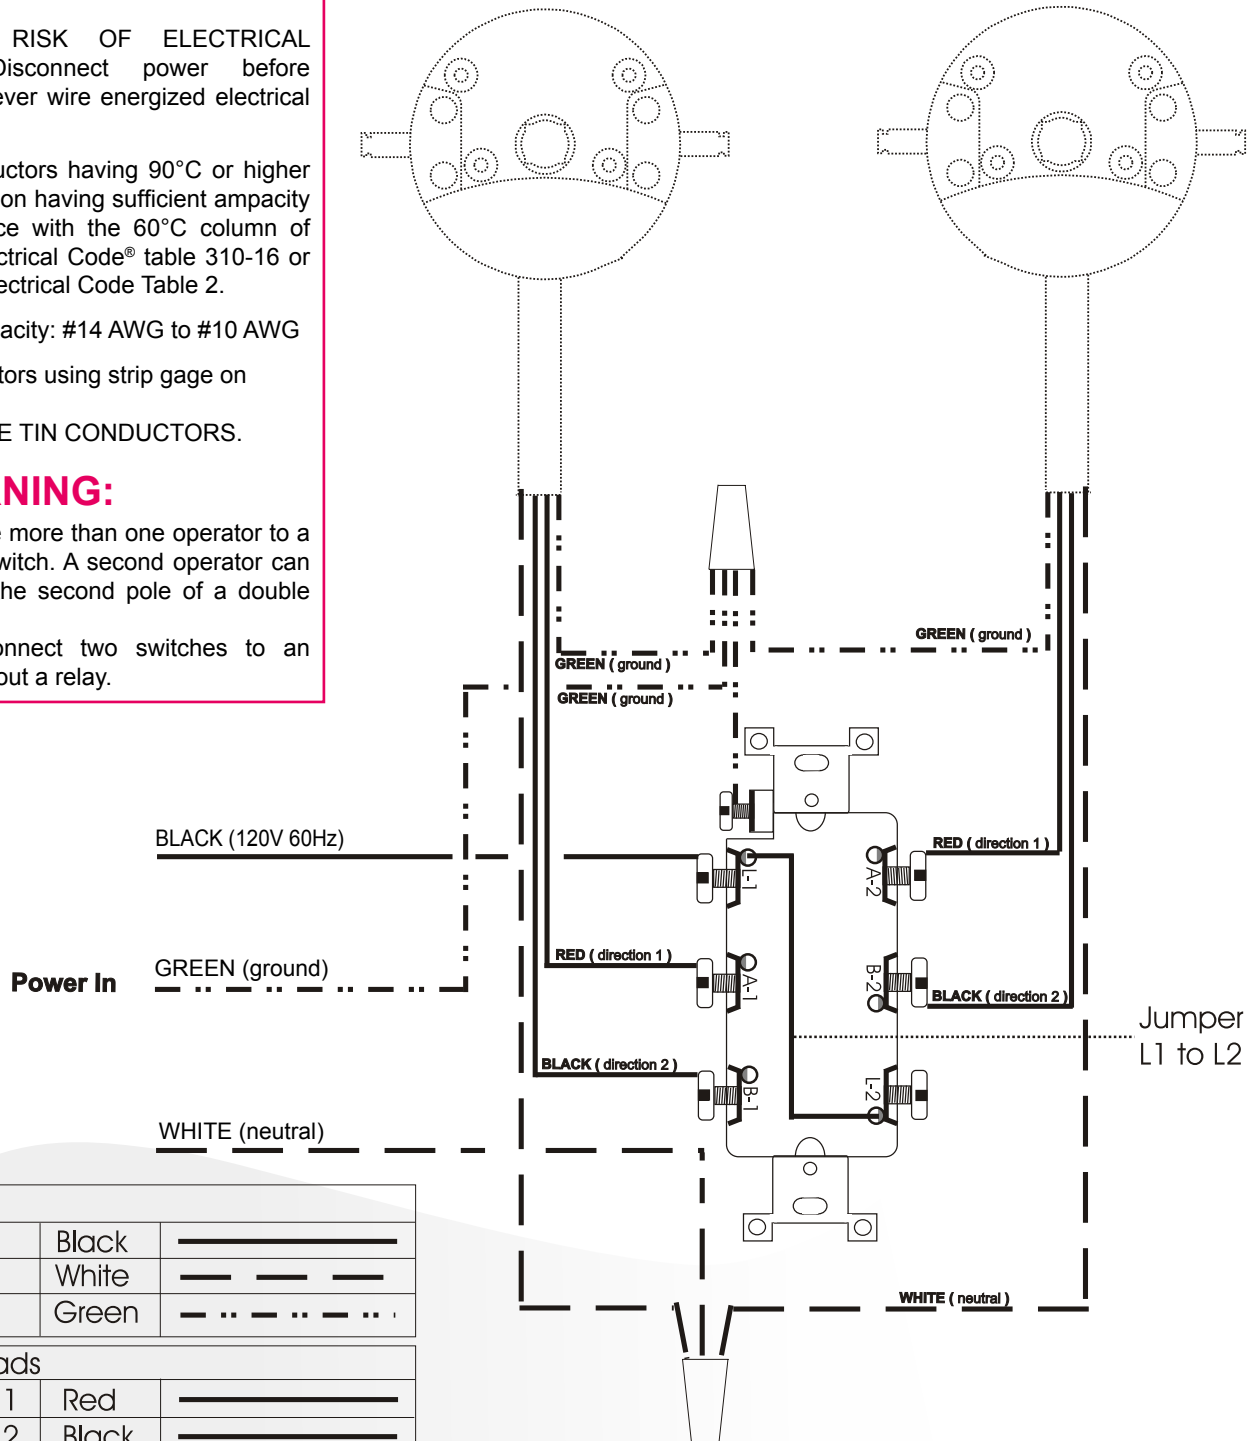

Power in		
Hot	Black	—————
Neutral	White	— — — — —
Ground	Green	- · - · - · - · - · - ·

Motor Leads		
Direction 1	Red	—————
Direction 2	Black	—————
Neutral	White	— — — — —
Ground	Green	- · - · - · - · - · - ·