


# RELAY GROUPS

## RG2 GROUP

### RG2 GROUP

- 2 RG2 Relays
- 4 Motors
- Low-Voltage Momentary Master Switch
- 4 Low-Voltage Momentary Individual Control Switches

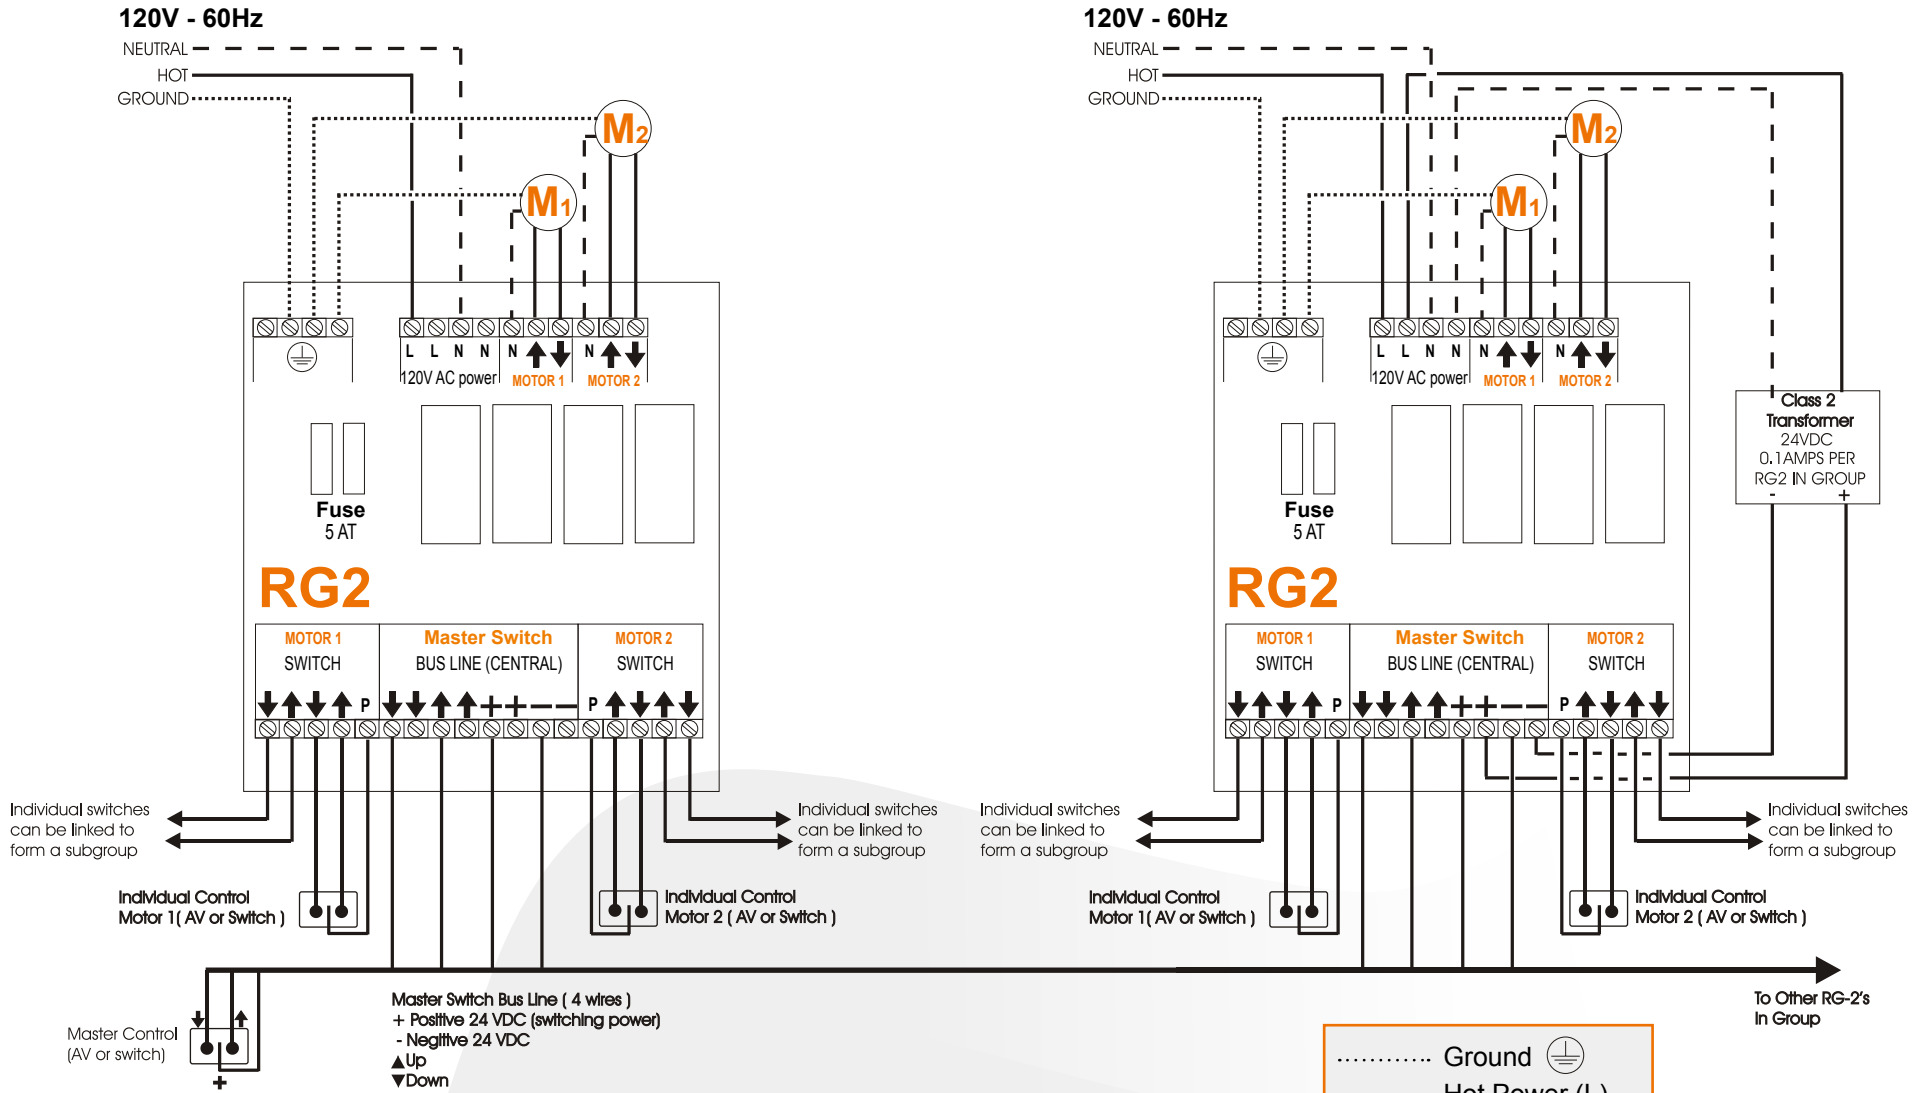

**NOTICE:** For installation by a qualified electrician in accordance with national and local electrical codes, and the following Instructions.

**CAUTION:** RISK OF ELECTRICAL SHOCK. Disconnect power before installing. Never wire energized electrical components.