


RELAY GROUPS

RI2 & RI3 GROUP

RI2 AND RI3 GROUP

- 5 Motors
- 1 Momentary Master Switch
- 5 Momentary Individual Switches (Optional)

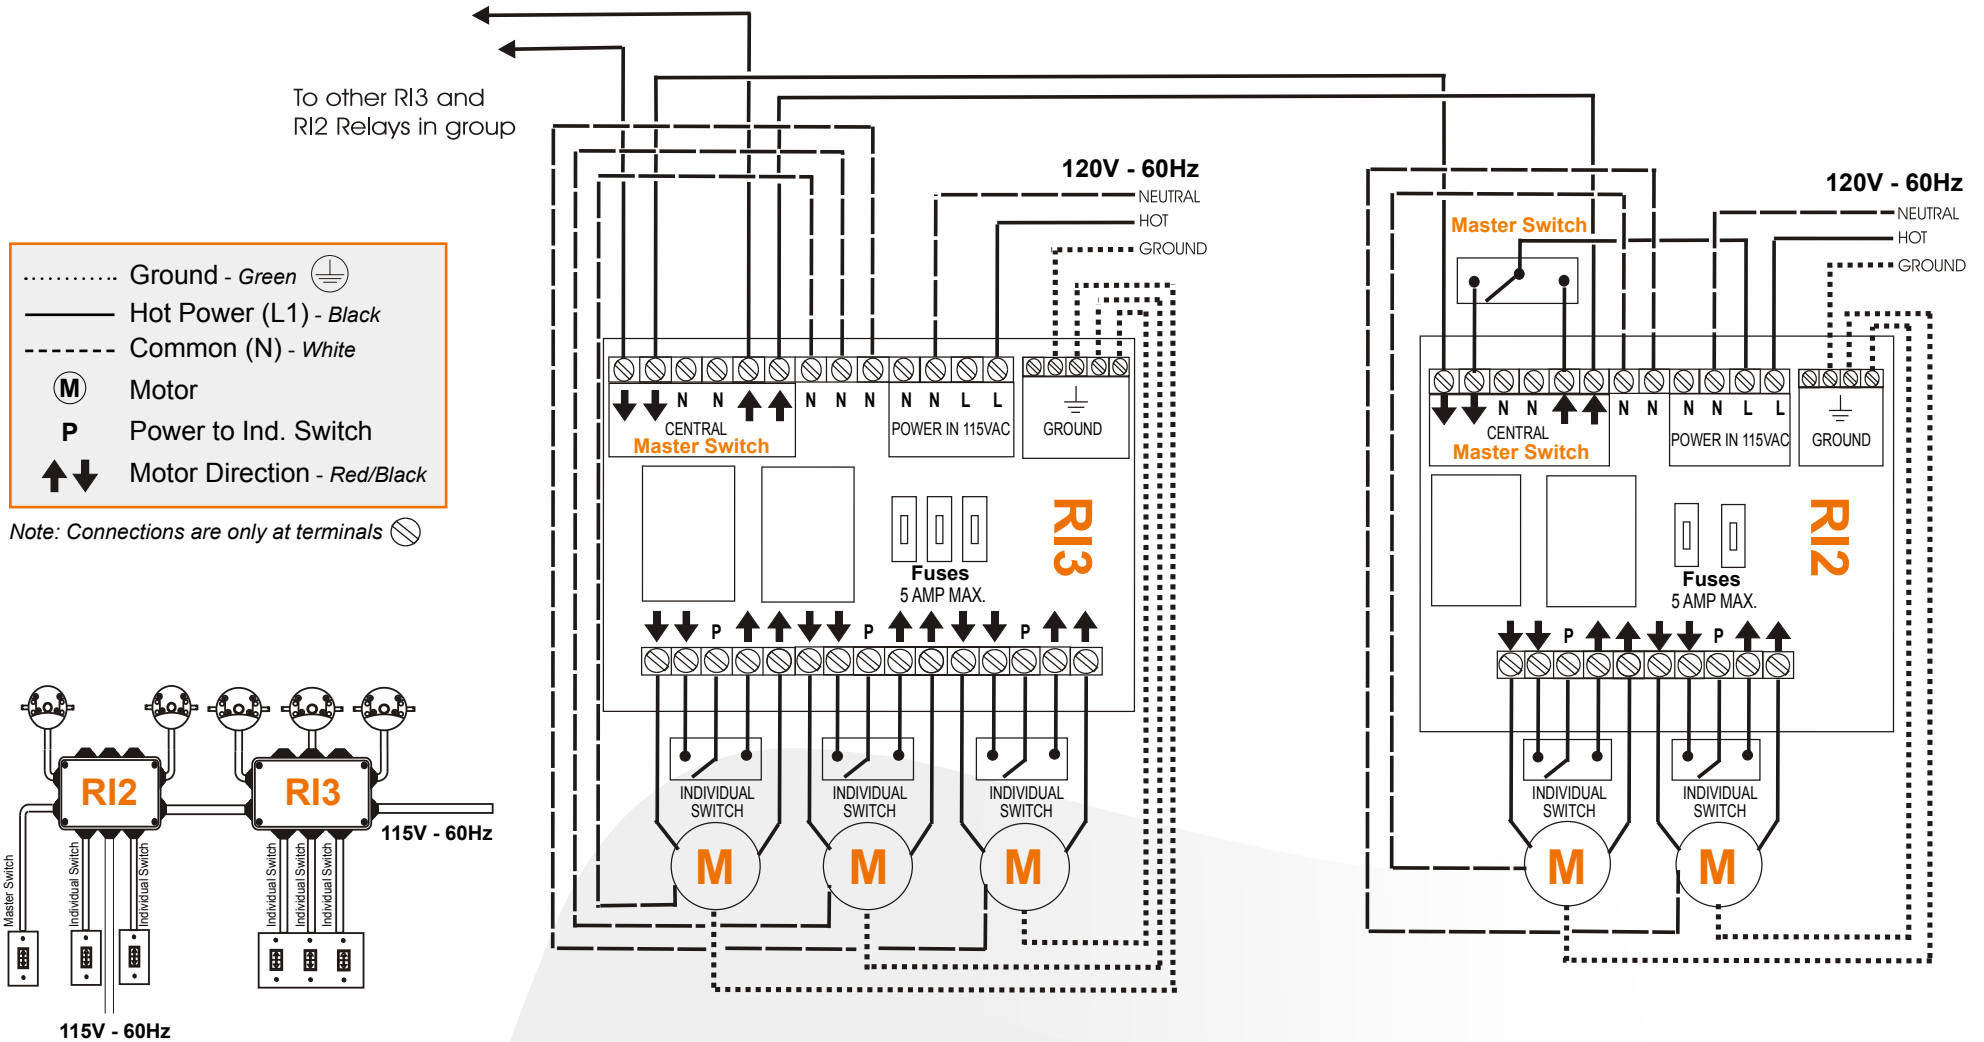

NOTICE: For installation by a qualified electrician in accordance with national and local electrical codes, and the following Instructions.

CAUTION: RISK OF ELECTRICAL SHOCK. Disconnect power before installing. Never wire energized electrical components.