


# RELAY GROUPS



## RI2 GROUP

### RI2 RELAY GROUP

- 4 Motors
- 1 Momentary Master Switch
- 4 Momentary Individual Switches (Optional)

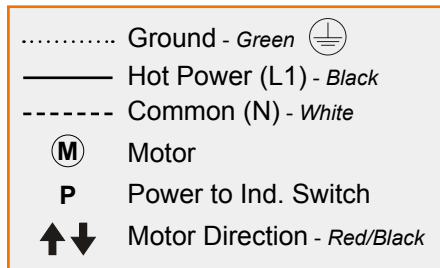

Note: Connections are only at terminals

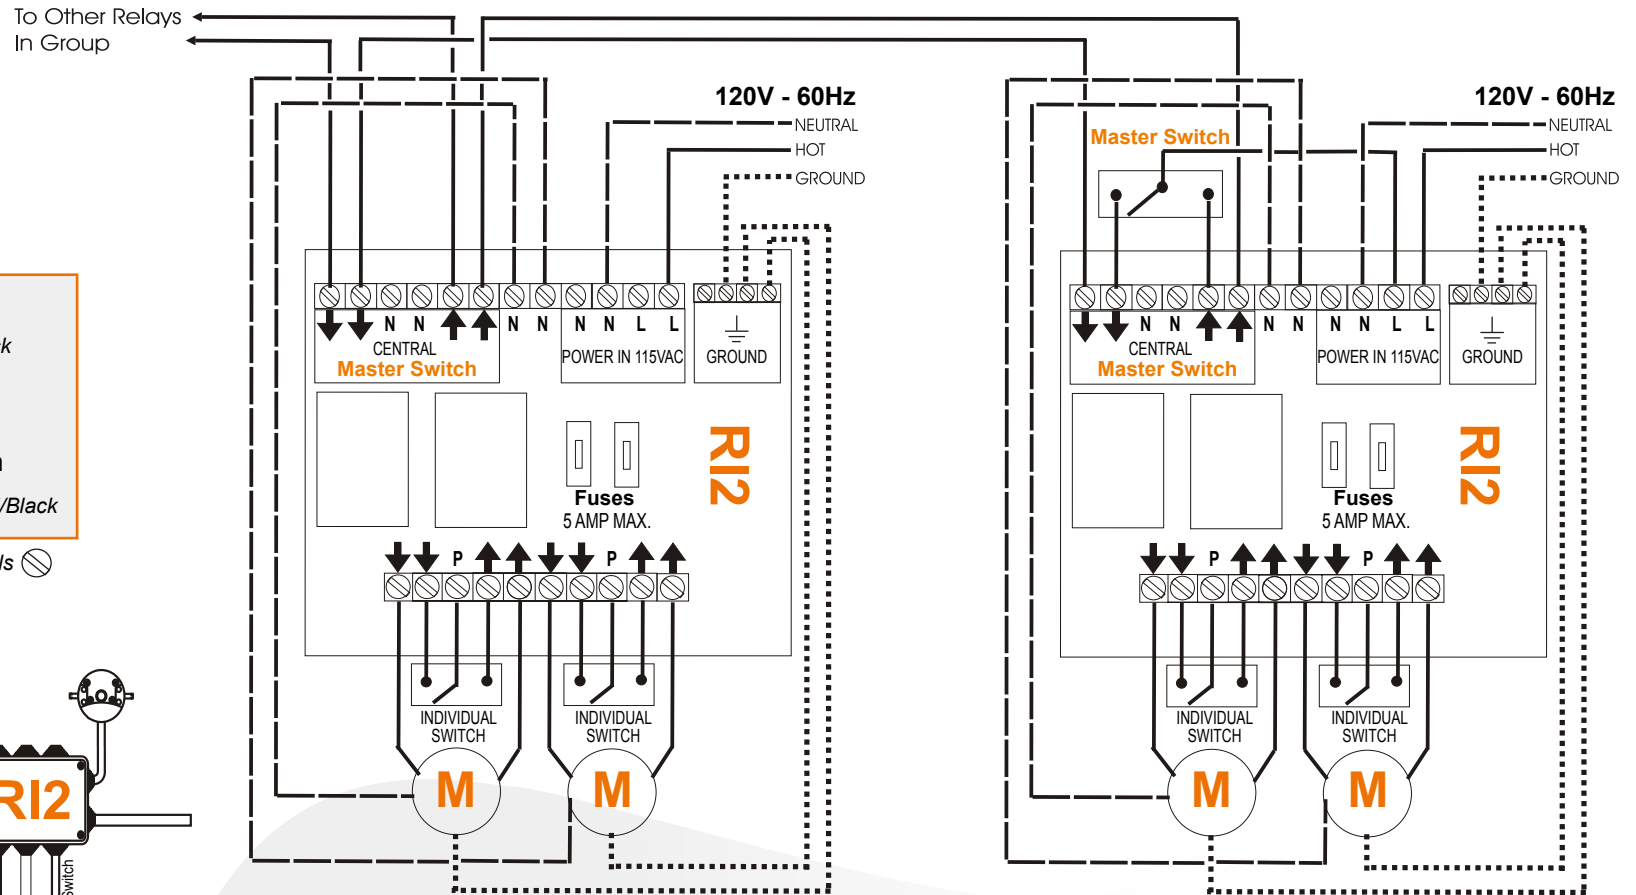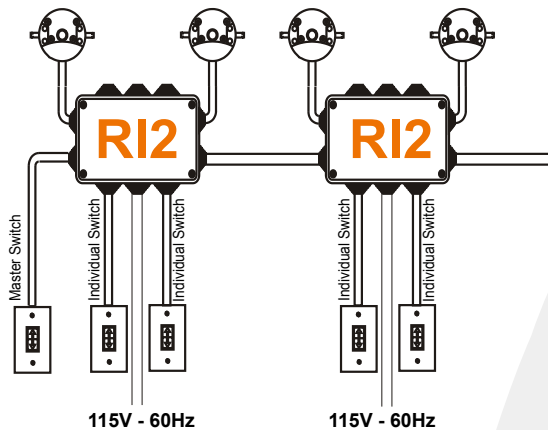

**NOTICE:** For installation by a qualified electrician in accordance with national and local electrical codes, and the following Instructions.

**CAUTION:** RISK OF ELECTRICAL SHOCK. Disconnect power before installing. Never wire energized electrical components.