
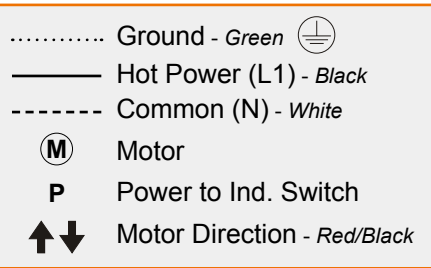
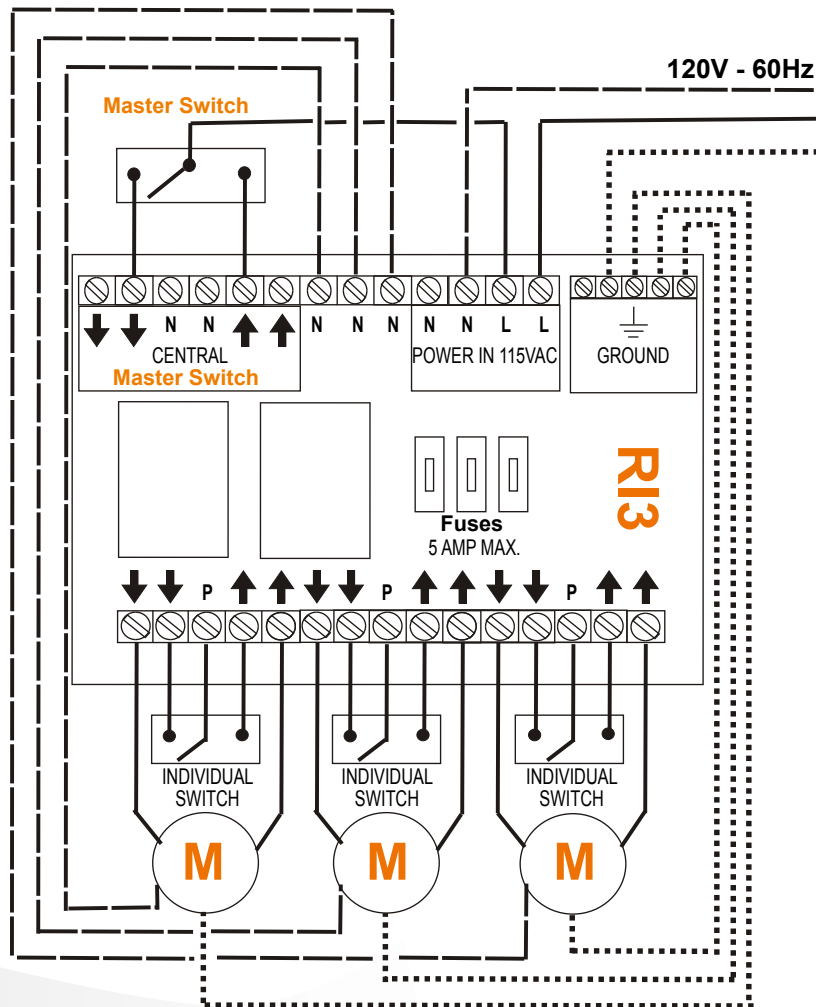


RELAY GROUPS

RI3

RI3

- 3 motors
- 1 Momentary Master Switch
- 3 Momentary Individual Control Switches (Optional)

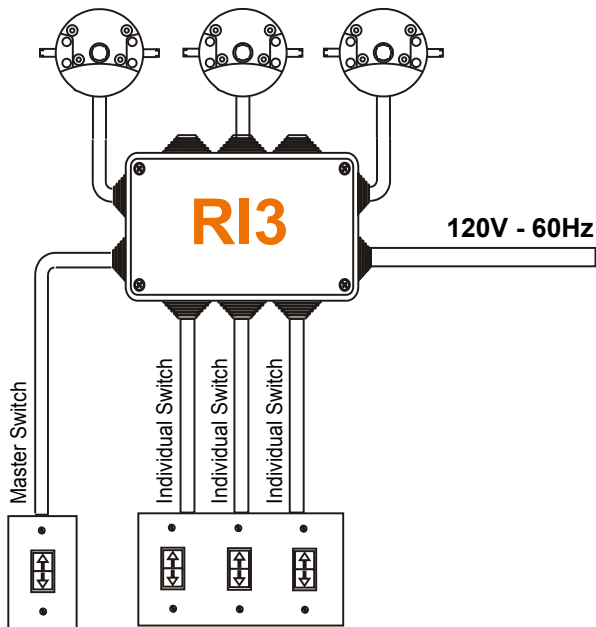

Note: Connections are only at terminals

NOTICE: For installation by a qualified electrician in accordance with national and local electrical codes, and the following instructions.

CAUTION: RISK OF ELECTRICAL SHOCK. Disconnect power before installing. Never wire energized electrical components.