
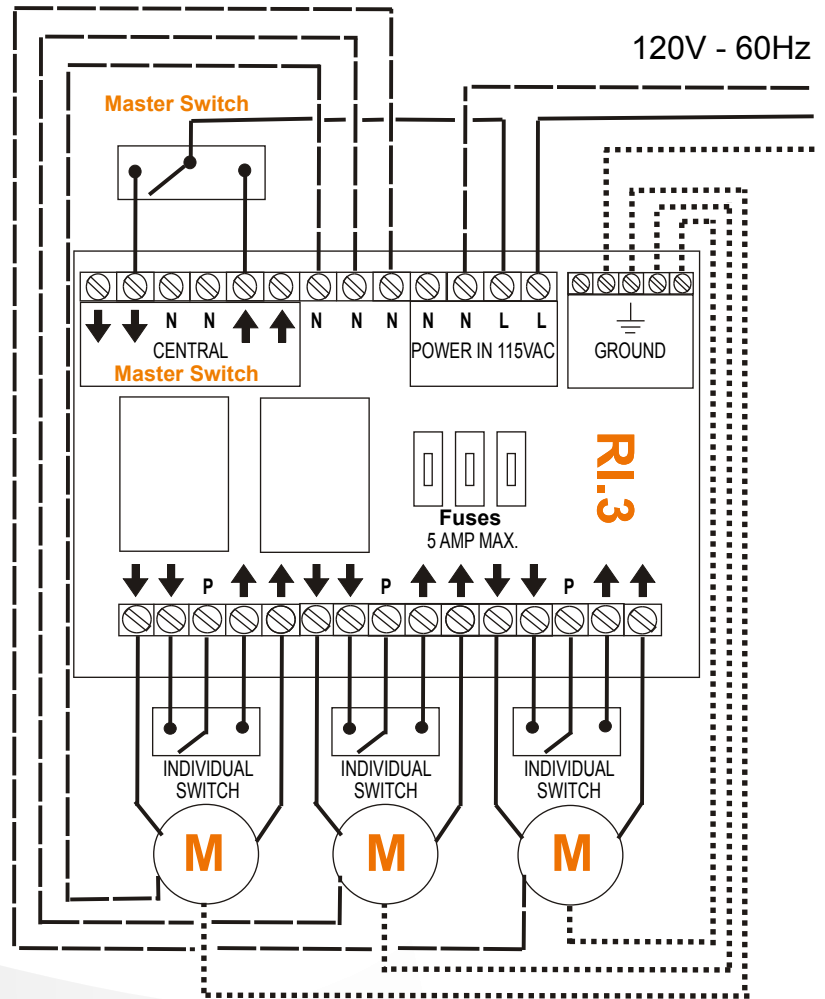


RELAY GROUPS

RI.3

RI.3

- 3 motors
- 1 Momentary Master Switch
- 3 Momentary Individual Control Switches (Optional)

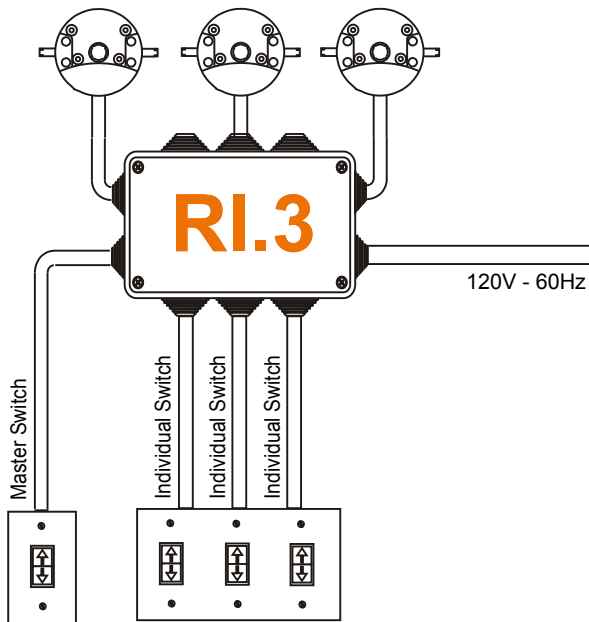

.....	Ground - Green	
————	Hot Power (L1) - Black	
-----	Common (N) - White	
	Motor	
P	Power to Ind. Switch	
	Motor Direction - Red/Black	

Note: Connections are only at terminals

NOTICE: For Installation by a qualified electrician in accordance with national and local electrical codes, and the following instructions.
CAUTION: : RISK OF ELECTRICAL SHOCK. Disconnect power before installing. Never wire energized electrical components.